



**Massachusetts Department of Environmental Protection  
Source Water Assessment and Protection (SWAP) Report  
For  
M.T.A. Toll Plaza 9**

**What is SWAP?**

The Source Water Assessment and Protection (SWAP) program, established under the federal Safe Drinking Water Act, requires every state to:

- ? Inventory land uses within the recharge areas of all public water supply sources;
- ? Assess the susceptibility of drinking water sources to contamination from these land uses; and
- ? Publicize the results to provide support for improved protection.

**SWAP and Water Quality**

Susceptibility of a drinking water source does *not* imply poor water quality. Actual water quality is best reflected by the results of regular water tests.

Water suppliers protect drinking water by monitoring for more than 100 chemicals, treating water supplies, and using source protection measures to ensure that safe water is delivered to the tap.

Prepared by the  
Massachusetts Department of  
Environmental Protection,  
Bureau of Resource Protection,  
Drinking Water Program

Date DRAFT Prepared:  
**October 16, 2003**

**Table 1: Public Water System (PWS) Information**

<i>PWS NAME</i>	MBTA Toll Plaza 9
<i>PWS Address</i>	Mile 78, 31 Massachusetts Turnpike
<i>City/Town</i>	Sturbridge, Massachusetts
<i>PWS ID Number</i>	2287026
<i>Local Contact</i>	Mr. George Furst
<i>Phone Number</i>	(781) 431-5020

<i>Well Name</i>	<i>Source ID#</i>	<i>Zone I (in feet)</i>	<i>IWPA (in feet)</i>	<i>Source Susceptibility</i>
Well #1	2287026-01G	100	407	High

**Introduction**

We are all concerned about the quality of the water we drink. Drinking water wells may be threatened by many potential sources of contamination, including septic systems, road salting, and improper disposal of hazardous materials. Citizens and local officials can work together to better protect these drinking water sources.

**Purpose of this report:**

This report is a planning tool to support local and state efforts to improve water supply protection. By identifying land uses within water supply protection areas that may be potential sources of contamination the assessment helps focus protection efforts on appropriate best management practices (BMPs) and drinking water source protection measures. Department of Environmental Protection (DEP) staff are available to provide information about funding and other resources that may be available to your community.

**This report includes:**

1. Description of the Water System
2. Discussion of Land Uses within Protection Areas
3. Recommendations for Protection
4. Attachments, including a Map of the Protection Areas
5. Appendix

**1. Description of the Water System**

Sturbridge Toll Plaza Interchange 9 obtains its water supply from a 140 feet deep rock well. The well is located in the basement in the northwesterly corner of the building. The well has a Zone I of 100 feet and an Interim Wellhead Protection Area (IWPA) of 407 feet. The IWPA provides an interim protection area for a water supply well when the actual recharge area has not been delineated. The actual recharge area to the well may be significantly larger or smaller than the IWPA. The well is located in an aquifer with a high vulnerability to contamination due to the absence of hydrogeologic barriers that can prevent contaminant migration. Please refer to the attached map of the Zone I and IWPA. The well serving the facility has no treatment at this time. The DEP requires public water suppliers to monitor the quality of the water. For current information on monitoring

### What is a Protection Area?

A well's water supply protection area is the land around the well where protection activities should be focused. Each well has a Zone I protective radius and an Interim Wellhead Protection Area (IWPA).

- **The Zone I** is the area that should be owned or controlled by the water supplier and limited to water supply activities.
- **The IWPA** is the larger area that is likely to contribute water to the well.

In many instances the IWPA does not include the entire land area that could contribute water to the well. Therefore, the well may be susceptible to contamination from activities outside of the IWPA that are not identified in this report.

### What is Susceptibility?

Susceptibility is a measure of a well's potential to become contaminated due to land uses and activities within the Zone I and Interim Wellhead Protection Area (IWPA).

results and treatment, please contact the Public Water System contact person listed above in Table 1. Drinking water monitoring reporting data is also available on the web via EPA's Envirofacts website at [http://www.epa.gov/enviro/html/sdwis/sdwis\\_query.html](http://www.epa.gov/enviro/html/sdwis/sdwis_query.html).

## 2. Discussion of Land Uses in the Protection Areas

There are a number of land uses and activities within the drinking water supply protection areas that are potential sources of contamination.

#### Key issues include:

1. **Inappropriate Activities in Zone Is;**
2. **Underground Storage Tank (UST) With Heating Oil; Transportation Corridor;**
3. **Septic System; and**
4. **Stormwater Catchbasin.**

The overall ranking of susceptibility to contamination for the well is from below, based on the presence of at least one from below threat land use or activity in the IWPA, as seen in Table 2.

1. **Zone Is** – Currently, the well does not meet DEP's restrictions, which only allow water supply related activities in Zone Is. The facility's Zone I contains the building, roads, and parking areas. The public water supplier owns and controls all land encompassed by the Zone I. Please note that systems not meeting DEP Zone I requirements must get DEP approval and address Zone I issues prior to increasing water use or modifying systems.

#### Recommendations:

- ✓ Remove all non-water supply activities from the Zone I to comply with DEP's Zone I requirements.
- ✓ Do not use road salt within the Zone I.

2. **Underground Storage Tank** –A 4,000 gallon UST with heating oil is within the Zone I and IWPA of all the well. The tank is double walled with leak detector. If managed improperly, USTs can be a potential contaminant source due to leaks or spills of the chemicals they store.

#### Recommendations:

- ✓ Comply with all provisions of the regulations regarding UST. Consult with the local fire department for any additional local code requirements regarding USTs.
- ✓ Any modifications to the UST must be accomplished in a manner consistent

**Table 2: Table of Activities within the Water Supply Protection Areas**

Potential Contaminant Sources	Zone I	IWPA	Threat	Comments
Fuel Storage Below Ground	No	Well #2	High	Heating oil tank-double walled with alarm
Transportation Corridor	Yes	Yes	Moderate	Massachusetts Turnpike (I90)
Parking lot, driveways & roads	Yes	Yes	Moderate	Limit road salt usage and provide drainage away from wells
Septic System	No	Yes	Moderate	See septic systems brochure in the appendix
Stormwater drains	Yes	Yes	Low	
Structures	Yes	Yes	-	Non-water supply structures in Zone I

\* -For more information on Contaminants of Concern associated with individual facility types and land uses please see the SWAP Draft Land Use / Associated Contaminants Matrix on DEP's website - [www.state.ma.us/de/p/brp/dws/](http://www.state.ma.us/de/p/brp/dws/).

with Massachusetts's plumbing, building, and fire code requirements.

## Glossary

**Zone I:** The area closest to a well; a 100 to 400 foot radius proportional to the well's pumping rate. To determine your Zone I radius, refer to the attached map.

**IWPA:** A 400 foot to ½ mile radius around a public water supply well proportional to its pumping rate; the area DEP recommends for protection in the absence of a defined Zone I I. To determine IWPA radius, refer to the attached map.

**Zone II:** The primary recharge area defined by a hydrogeologic study.

**Aquifer:** An underground water-bearing layer of permeable material that will yield water in a usable quantity to a well.

**Hydrogeologic Barrier:** An underground layer of impermeable material that resists penetration by water.

**Recharge Area:** The surface area that contributes water to a well.

- 3. Storm Water Catch Basin** – Catch basins transport storm water from the roadway and adjacent properties to the ground. As flowing storm water travels, it picks up debris and contaminants from streets, parking areas and lawns. Common potential sources of contamination include lawn chemicals, pet waste, leakage from dumpsters, household hazardous waste, and contaminants from vehicle leaks, maintenance, washing or accidents.

### Recommendation:

- ✓ Work with the Town of Sturbridge to have the catch basins inspected, maintained, and cleaned on a regular schedule. Additionally, street and parking lot sweeping reduces the amount of potential contaminants in storm runoff.
- ✓ The Department recommends the public water supplier consider nonstructural techniques such as parking lot sweeping to reduce the amount of potential contaminants in storm water runoff. Additionally, the public water supplier may want to consider structural BMPs (e.g. stormwater swale, detention basin, etc.) as part of comprehensive storm water management plan for the site (refer to Storm Water Management Handbook, Volume 1 and 2 for information on BMPs).

- 4. Septic system** - The septic systems is located within the IWPA of the wells. If a septic system fails or is not properly maintained it could be a potential source of microbial contamination. Improper disposal of household hazardous chemicals to septic systems is a potential source of contamination to the water supply.

### Recommendations:

- ✓ Staff should be instructed on the proper disposal of spent household chemicals. Include custodial staff and certified operator.
- ✓ Septic system components should be located, inspected, and maintained on a regular basis. Refer to the appendices for more information regarding septic systems.

- 5. Transportation corridor** - Route 90 (Massachusetts Turnpike) is located within the Zone 1 and IWPA. Route 90 is one of the main roads through the State, which increases the chances of contamination from accidents or spills and road salt.

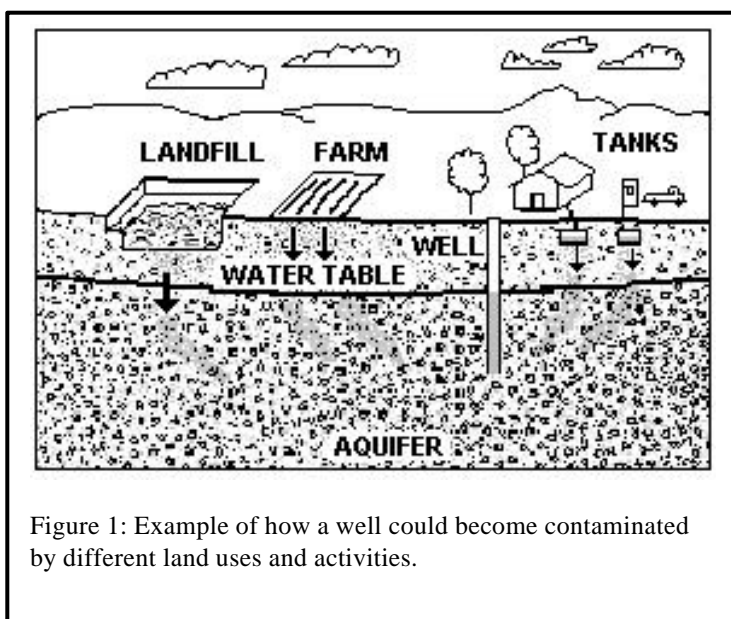


Figure 1: Example of how a well could become contaminated by different land uses and activities.

### Recommendations:

- ✓ Contact your local fire department to ensure that the IWPA is included in emergency response planning.
- ✓ Regarding salt use, work with your local highway supervisor to encourage reducing road salt use in your IWPA.

Implementing the following recommendations will reduce the system's susceptibility to contamination.

## 3. Protection Recommendations

Implementing protection measures and best management practices (BMPs) will reduce the well's susceptibility to contamination. MBTA Toll Plaza should review and adopt the key recommendations above and the following:

### For More Information:

Contact **Josephine Yemoh-Ndi** in DEP's **Worcester Office** at **(508) 792-7650 x 4030** for more information and for assistance in improving current protection measures.

More information relating to drinking water and source protection is available on the Drinking Water Program web site at:

[www.state.ma.us/dep/brp/dws/](http://www.state.ma.us/dep/brp/dws/)

### Additional Documents:

To help with source protection efforts, more information is available by request or online at [www.state.ma.us/dep/brp/dws/](http://www.state.ma.us/dep/brp/dws/), including:

1. Water Supply Protection Guidance Materials such as model regulations, Best Management Practice information, and general water supply protection information.
2. MA DEP SWAP Strategy
3. Land Use Pollution Potential Matrix
4. Draft Land/Associated Contaminants Matrix

Copies of this assessment have been made available to the public water supplier and town boards.

### Zone I:

- ✓ Keep non-water supply activities out of the Zone I.
- ✓ Consider well relocation if Zone I threats cannot be mitigated.
- ✓ Since MBTA intends to continue utilizing the structures in the Zone I, use BMPs and restrict activities that could pose a threat to the water supply.
- ✓ Upgrade to propane or natural gas for back-up power sources.

### Training and Education:

- ✓ Train staff on proper hazardous material use, disposal, emergency response, and best management practices; include certified operator. Post labels as appropriate on raw materials and hazardous waste.
- ✓ Post drinking water protection area signs at key visibility locations.

### Facilities Management:

- ✓ Implement standard operating procedures regarding proper storage, use and disposal of hazardous materials. To learn more, refer to <http://www.state.ma.us/dep/bwp/dhm/files/sqgsum.pdf> for the Requirements for Small Quantity Generators.

### Planning:

- ✓ Work with local officials in Sturbridge to include the facility IWPA in Aquifer Protection District Bylaws and to assist you in improving protection.
- ✓ Have a plan to address short-term water shortages and long-term water demands. Keep the phone number of a bottled water company readily available.
- ✓ Supplement the SWAP assessment with additional local information and incorporate it into water supply educational efforts. Use a land use inventory to assist in setting priorities, focusing inspections, and creating educational activities.

These recommendations are only part of your ongoing local drinking water source protection. Citizens and community officials should use this SWAP report to spur discussion of local drinking water protection measures.

## 4. Attachments

- Map of the Public Water Supply (PWS) Protection Area.
- Recommended Source Protection Measures Factsheet
- Your Septic System Brochure

